




EDINA BUILDING SAFETY POLICY/INFORMATION <sub>1</sub>			
subject Sump pump discharge connections		ECC 445.07 & 1035.03, Subd. 3	
department Inspections Department		code reference	
policy number SP-006-B <sub>2</sub>	revision number 2 on 6/16/11	approval <i>Andrew C. Richardson</i>	effective date 10/17/05
			page number 1 of 1
1. All Building Safety sheets adopted by Fire Department and Inspections Department. 2. Sheet numbers with B suffix developed by Inspections Dept. Sheet numbers with F suffix developed by Fire Dept.			



**Purpose:** Provide requirements for the installation of below grade piping for allowable clear water discharges from single family dwellings.


**Scope:** Provisions are limited to water from roofs, lawns, yards foundation drains and sump pumps.

1. Piping shall be installed as shown in the following details. A direct connection to sump pump or roof drains is prohibited.
2. A permit and inspection(s) are required to be obtained from the Inspections Department.

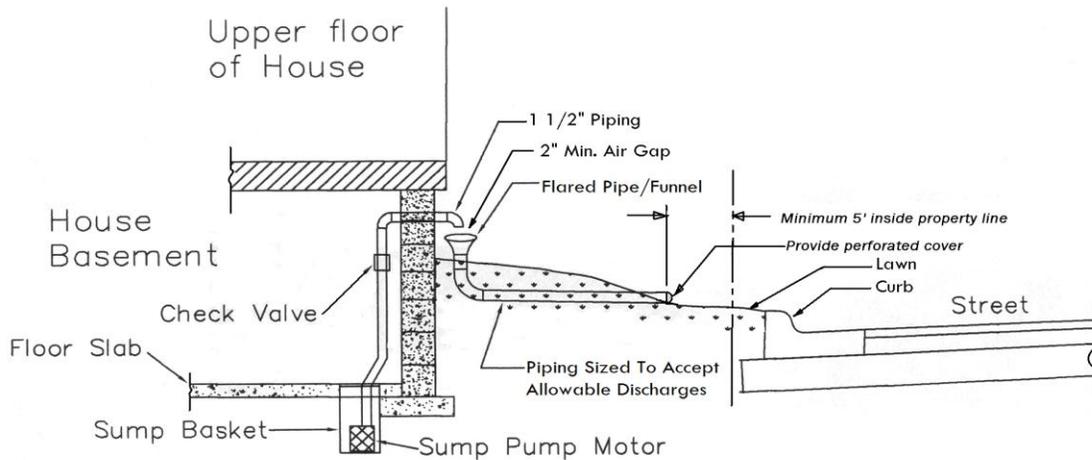

Not To Scale

Surface Discharge  
10/17/05, revised 6/16/11

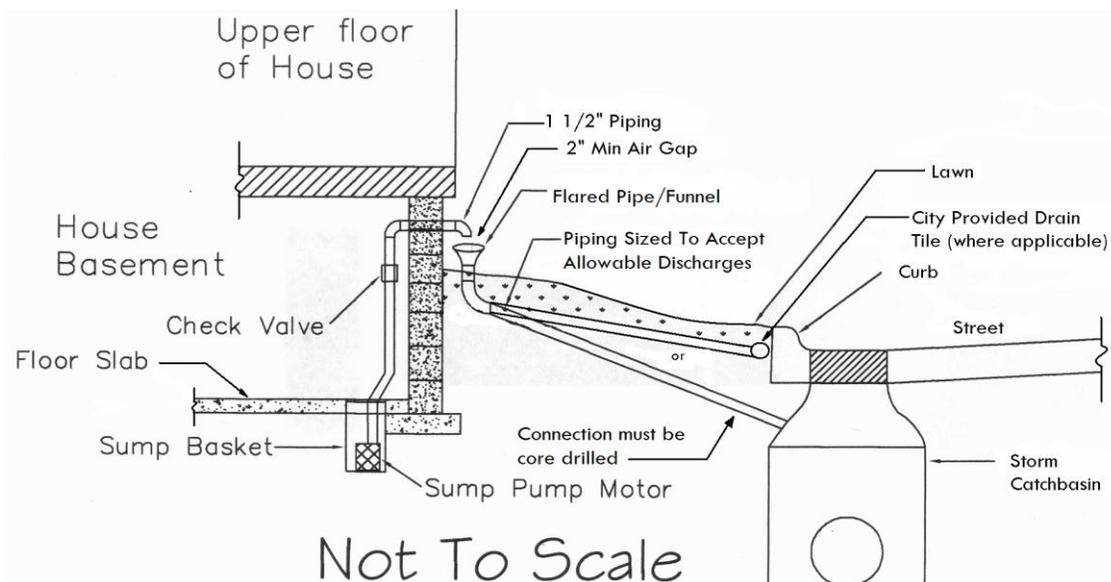

Not To Scale

Sump Discharge to Storm Sewer  
10/11/05, revised 6/16/11